



Phone : 0861-2317963,64,68

Fax : 0861-2300425

NARAYANA EDUCATIONAL SOCIETY

Regd. No. 319/96

14/72. HARANATHAPURAM,
NELLORE-524003.(A.P)

Date: 04.03.2021

DECLARATION

This is to declare that Narayana Educational Society, Nellore, has established Narayana Medical College, Nellore in the year 1999. The pre and Para clinical laboratory facilities (Anatomy, Physiology, Microbiology, Bio-chemistry, Pathology and Pharmacology) are established as per National Medical Commission norms and maintain by Narayana Educational Society. Narayana Medical College and the clinical facilities are available at the parent hospital for students of Narayana College of Nursing, Nellore for the **academic year 2021-22.**


This is also to declare that the students of Narayana College of Nursing shall have the pre clinical experience in Anatomy lab, Physiology lab, Microbiology lab, Bio-chemistry lab, Pathology lab and Pharmacology labs at Narayana Medical College and Narayana Medical College Hospital for the **academic year 2021-22.**




A. S. Reddy
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.


S. S. Srinivas

SECRETARY

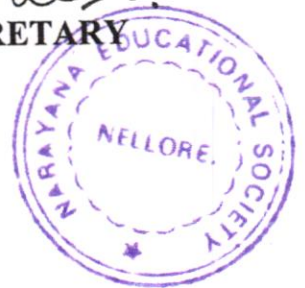

B. Srinivas
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003


NARAYANA
 MEDICAL COLLEGE AND HOSPITAL
ORGONOGRAM

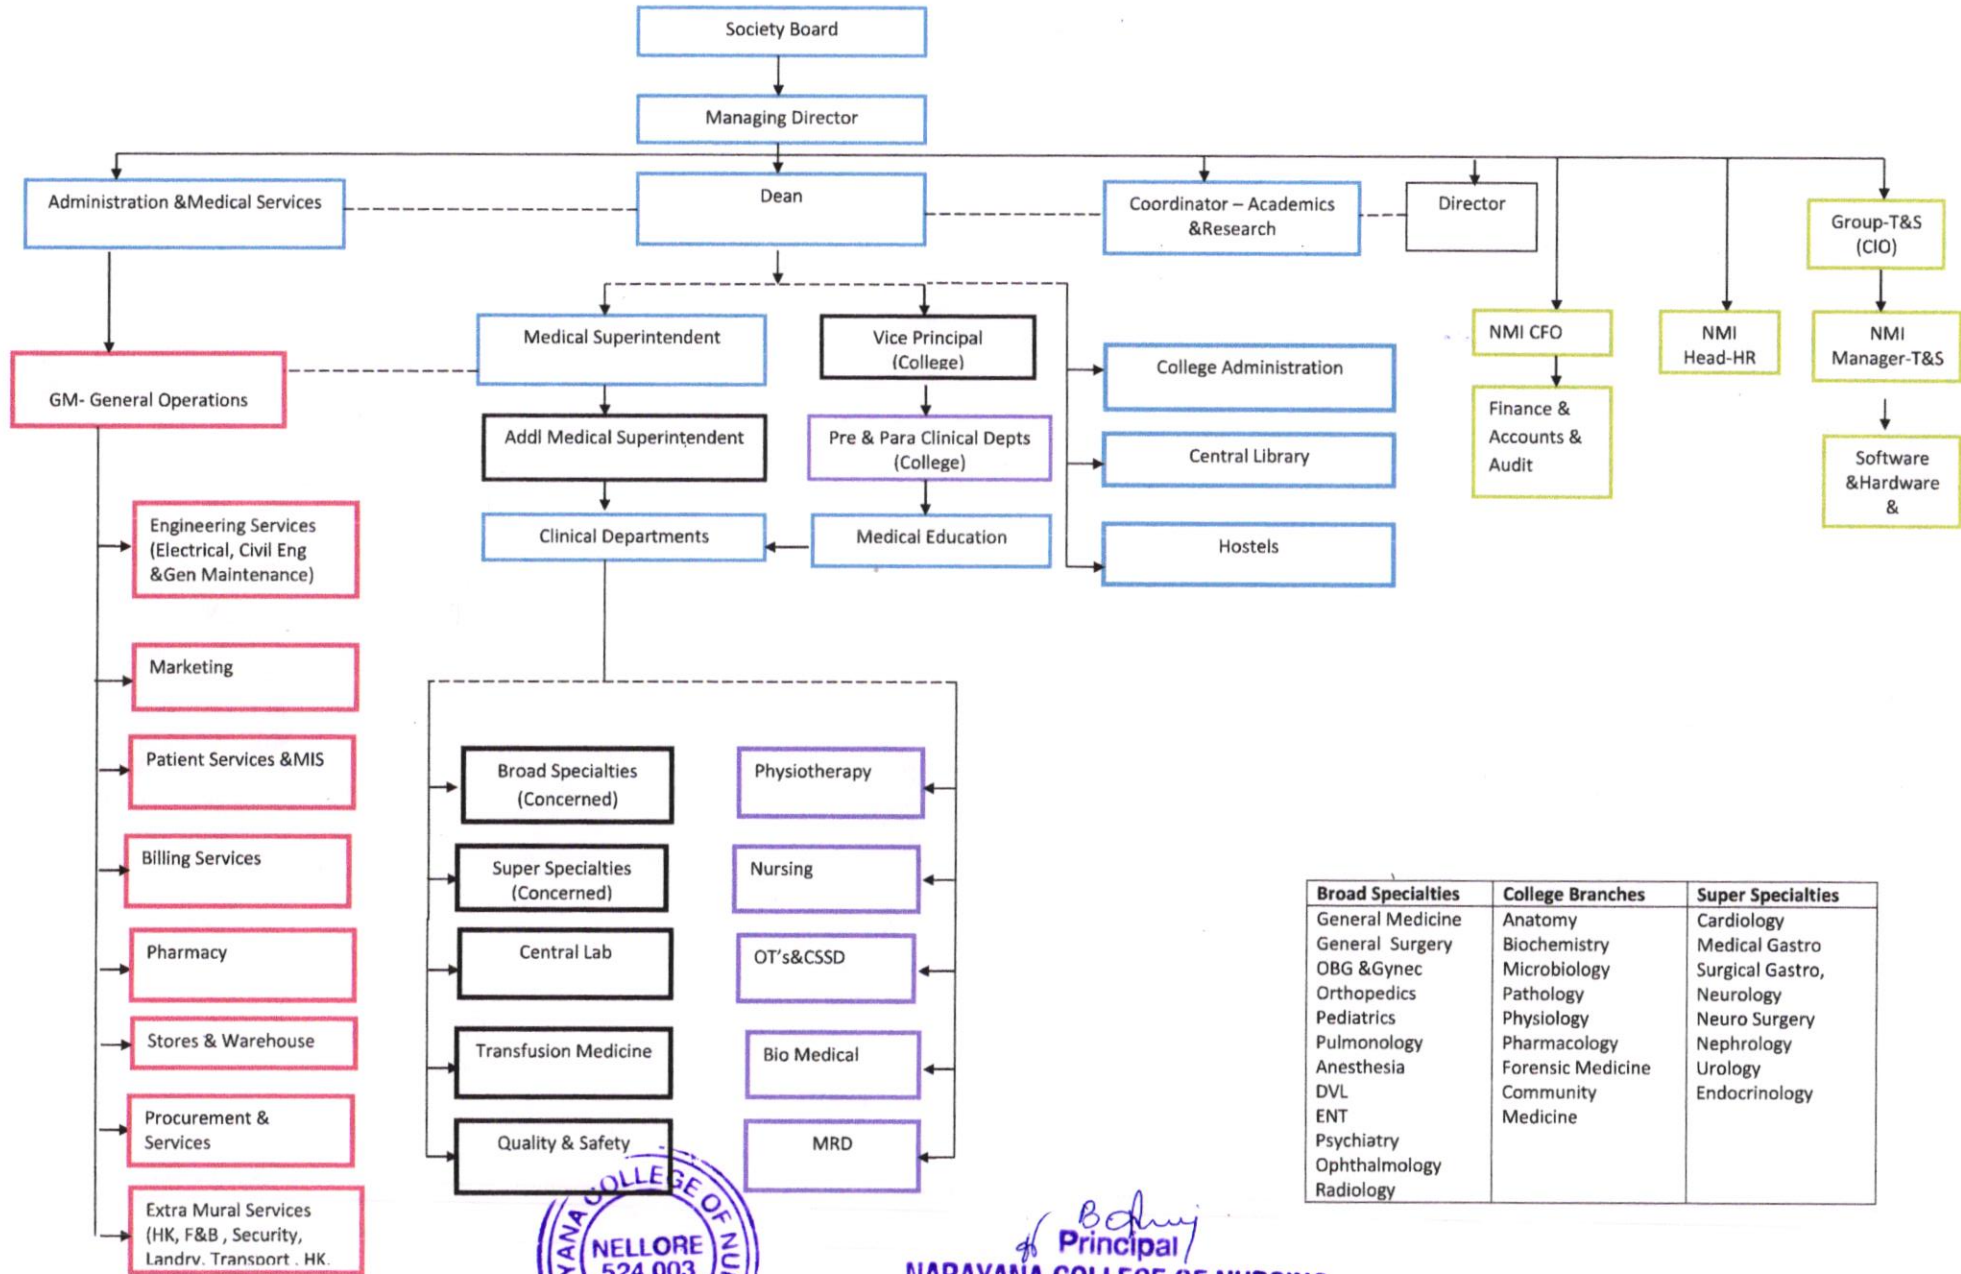

Broad Specialties	College Branches	Super Specialties
General Medicine	Anatomy	Cardiology
General Surgery	Biochemistry	Medical Gastro
OBG & Gynec	Microbiology	Surgical Gastro,
Orthopedics	Pathology	Neurology
Pediatrics	Physiology	Neuro Surgery
Pulmonology	Pharmacology	Nephrology
Anesthesia	Forensic Medicine	Urology
DVL	Community	Endocrinology
ENT	Medicine	
Psychiatry		
Ophthalmology		
Radiology		



Bahuy
 Principal
NARAYANA COLLEGE OF NURSING
 Chinthareddypalem,
 NELLORE - 524 003.



NARAYANA
COLLEGE OF NURSING

Chinthareddypalem, Nellore - 524003, A.P.

Ph No: 0861 2317969 - Fax: 0861 2311968

Recognized by Indian Nursing Council and A.P. Nurses & Midwives Council

Affiliated to NTR University of Health Sciences, A.P. Vijayawada.

Accredited by "International Accreditation Organization (IAO)"

website: www.narayananursingcollege.com, e-mail: narayana_nursing@yahoo.co.in



AWARDS AND ACCREDITATION



IAO

Certificate of International Accreditation

Granted to

Narayana College of Nursing

for achievement of the highest standards in Organizational Management, Academic Management, and Institutional Performance through a commitment to quality and continuous improvement.

IAO

Feb 22, 2025

Valid Through

Accreditation Committee



B. Jany
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.



National Accreditation Board for
Testing and Calibration Laboratories

CERTIFICATE OF ACCREDITATION

**CENTRAL LABORATORY, NARAYANA MEDICAL
COLLEGE AND HOSPITAL (A UNIT OF NARAYANA
EDUCATIONAL SOCIETY)**

has been assessed and accredited in accordance with the standard

ISO 15189:2012

**"Medical laboratories - Requirements for quality and
competence"**

for its facilities at

CHINTHAREDDYPALEM, NELLORE, ANDHRA PRADESH, INDIA

in the field of

Medical Testing

Certificate Number: MC-3823

Issue Date: 19/10/2020

Valid Until: 18/10/2022

This certificate remains valid for the Scope of Accreditation as specified in the annexure subject to continued satisfactory compliance to the above standard & the relevant requirements of NABL.
(To see the scope of accreditation of this laboratory, you may also visit NABL website www.nabl-india.org)

Name of Legal Identity : Narayana Educational Society

Signed for and on behalf of NABL




B. Anurag
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003

Herliteswari

A. Gowri
N. Venkateswaran
Principal Chief Executive Officer



NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.



Devi



Policy on use of Clinical and Simulation Lab

1.1.Preface:

Narayana College of Nursing believes that Nursing is core part in health service delivery system in which health promotion, disease prevention; curative and rehabilitative health strategies are applied. The clinical nursing skills for the nurses are of paramount important not only to provide comprehensive care but also enhance clinical competence.

1.2. Applicability:

The policy shall be applicable for all faculties and all nursing students who are studying various Nursing Courses in Narayana College of Nursing.

1.3.Objectives of the Policy:

- To provide a safe learning environment for the undergraduate, post graduate nursing curriculum to teach and assess students in a patient-centered care.
- To provide not only comprehensive care but also enhance clinical competence.
- To equip nurses with basic clinical nursing skills, which will enable them to dispatch their responsibility as well as to develop uniformity in all health care settings.
- To develop competency in basic clinical skills, advances clinical skills, special skills to care the children, accouchement care, Geriatric care, as well as fundamental concepts related to the skills.
- Simulations are used in all the departments.
- Special lab settings for nursing foundation with mannequins and dummies. All the skills are practiced in labs before going to clinical area.

1.4.Purposes of the policy

- To enhance the utilization of all Labs
- To follow the policies of the concerned labs.
- To train in all labs before posted to clinical areas.

B. Anny
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003



A. Srin
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.



NARAYANA
COLLEGE OF NURSING

Chinthareddypalem, Nellore - 524003. A.P.

Ph No: 0861-2317969 | Fax: 0861-2311968.

Recognized by Indian Nursing Council and A.P. Nurses & Midwives Council

Affiliated to NTR University of Health Sciences, A.P. Vijayawada.

Accredited by "International Accreditation Organization (IAO)"

website: www.narayanannursingcollege.com | | e-mail: narayana_nursing@yahoo.co.in



Plan of action

- All nursing students will be trained in labs to horn their skills of all procedures.
- Lab rotation will be done according to the Master, and clinical rotation plans
- The practical period will be planned based on affiliating body and INC.
- The hours of lab training will be followed by the curriculum.

FACILITIES FOR TRAINING: OUR MANNEQUINS

- ❖ Mama Birthie (Birth Simulators)
- ❖ Inter Changeable Catheterization And Enema Trainer
- ❖ Suture Tutor Kit
- ❖ Adult Multi Venous Iv Arm And Arterial Arm Stick Trainer
- ❖ Airway Management Trainer Adult
- ❖ Intra Muscular Buttock Injection Trainer
- ❖ Clinical Female Pelvic Trainer
- ❖ Neonatal
- ❖ Breast Examination Trainer
- ❖ BIs Mannequin
- Advanced Life Support (Als) Patient Simulator

B. Anny
Principal

NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003



A. S. Reddy
Principal

NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.



Chinthareddypalem, Nellore - 524003, A.P.

Ph No: 0861-2317969 | Fax: 0861-2311968.

Recognized by Indian Nursing Council and A.P. Nurses & Midwives Council

Affiliated to NTR University of Health Sciences, A.P. Vijayawada.

Accredited by "International Accreditation Organization (IAO)"

website: www.narayanannursingcollege.com || e-mail: narayana_nursing@yahoo.co.in

SCHEDULE FOR III B.Sc.(N) SIMULATION LAB PRACTICE 2021-2022

MEDICAL SURGICAL NURSING LAB					
PROCEDURE & DATE	BLS/ ACLS	VENI PUNCTURE	ET TUBE INTUBATION	SUCTIONING	CENTRAL LINE INSERTION
20-09-2021	GROUP-I	GROUP-II	GROUP-III	GROUP-IV	GROUP-V
21-09-2021	GROUP-II	GROUP-III	GROUP-IV	GROUP-V	GROUP-I
22-09-2021	GROUP-III	GROUP-IV	GROUP-V	GROUP-I	GROUP-II
23-09-2021	GROUP-IV	GROUP-V	GROUP-I	GROUP-II	GROUP-III
24-09-2021	GROUP-V	GROUP-I	GROUP-II	GROUP-III	GROUP-IV
25-09-2021	GROUP-VI	GROUP-VII	GROUP-VIII	GROUP-IX	GROUP-X
27-09-2021	GROUP-VII	GROUP-VIII	GROUP-IX	GROUP-X	GROUP-VI
28-09-2021	GROUP-VIII	GROUP-IX	GROUP-X	GROUP-VI	GROUP-VII
29-09-2021	GROUP-IX	GROUP-X	GROUP-VI	GROUP-VII	GROUP-VIII
30-09-2021	GROUP-X	GROUP-VI	GROUP-VII	GROUP-VIII	GROUP-IX

B. Chinnay
Principal

NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003



A. Indira

PRINCIPAL

Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003



Chinthareddypalem, Nellore - 524003. A.P.

Ph No: 0861-2317969 | Fax: 0861-2311968.

Recognized by Indian Nursing Council and A.P. Nurses & Midwives Council

Affiliated to NTR University of Health Sciences, A.P. Vijayawada.

Accredited by "International Accreditation Organization (IAO)"

website: www.narayanannursingcollege.com | e-mail: narayana_nursing@yahoo.co.in

III B.Sc (N) NAME LIST (2021-2022)

S.NO	Student Name	GROUP
1.	Adithyalakshmi T A	GROUP-I
2.	Aiswarya D	
3.	Aksa Mariam Johnson	
4.	Aksa Rejimon	
5.	Aleena Joby	
6.	Aleena Sabu	
7.	Aneena George	
8.	Anithamol Joy	
9.	Anjal Anil	
10.	Anjaly Martin	GROUP-II
11.	Anna Maria Soy	
12.	Annu Thomas	
13.	Anu James	
14.	Ashily Rose Baby	
15.	Ashly Biju	
16.	Bijitha Biju	
17.	Blessy Benny	
18.	Blessy Mariya Mathew	
19.	Darshana Joseph	GROUP-III
20.	Dayana Anna Abraham	
21.	Devika Binu	
22.	Devika Santhosh	
23.	Divya Babu	
24.	Dona Sunil	
25.	Jancy Jemini	
26.	Joice George	
27.	Juby Jose	
28.	Kripa Sreekumar	GROUP-IV
29.	Lisbet Joshy	
30.	Mariya Aby	
31.	Mariya Francis	



B. Jany
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003

32.	Mariya Mathew	
33.	Mibila Baby	
34.	Priyanka Johny	
35.	Remya George	
36.	Rinta Sebastian	
37.	Sainu Susan Sunny	
38.	Sanjana Sabu	
39.	Sannu Saji	
40.	Seeba Biju	GROUP-V
41.	Selin Susan Chacko	
42.	Shintu Anna Kuriakose	
43.	Simi Sabu	
44.	Sinjumol Sabu	
45.	Sneha Babu	
46.	Sneha Jomon	
47.	Sreekutty K S	
48.	Suryalakshmy S	
49.	Tintumol Joseph	
50.	Vinaya Thilak	GROUP-VI
51.	Aksha Theresa Kurian	
52.	Akza Varghese	
53.	Anagha Anilkumar	
54.	Ani Elizabeth Antony	
55.	Anne Susmitha	
56.	Annu Abraham	
57.	Ansu Saji	
58.	Ashly Sali	
59.	Aswathy K A	
60.	Besna Babu	GROUP-VII
61.	Bincy P Benson	
62.	Boncey B Kottoor	
63.	Divya Babu	
64.	Dona Maria Tomy	
65.	Elsa K Abugy	
66.	Ganga S	
67.	Gopika M G	
68.	Gowri Jayaprakash	
69.	Grace Mary P M	



B. Sanyal
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003

70.	Harsha Babu	GROUP-VIII
71.	Hebzeeba Babu	
72.	Jelita Maria John	
73.	Jisini Annie John	
74.	Kochurany Varghese	
75.	Lintu V Joseph	
76.	Mariya Skaria	
77.	Nayana Rajeev	
78.	Neenu Sabu	
79.	Neethu Sabu	
80.	Nithy K Tomy	GROUP-IX
81.	Rani Raj B R	
82.	Shalu Mary Shaji	
83.	Sherine S Thomas	
84.	Sneha Kunjumon	
85.	Sona K	
86.	Sophy Rose Devasia	GROUP-X
87.	Sruthi L	
88.	Stephy Jacob	
89.	Surya Suresh	
90.	Vinaya Anna Vinod	
91.	Yememma Jose	
92.	Aleena Emmanuel	

B. Anuj
Principal

NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003



A. Indira

PRINCIPAL

Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003

GOVERNMENT OF ANDHRA PRADESH
STATE DISASTER RESPONSE & FIRE SERVICES DEPARTMENT

From :
The Director General,
State Disaster Response and Fire Services,
Andhra Pradesh, Vijayawada.

To :
The District Medical &
Health Officer,
SPSR Nellore.

Re.No.15742/NLR/RFO/2020, Dated:23-12-2021,

Sir,

Sub: A.P. State Disaster Response and Fire Services Department-MSB Section-Issuance of Renewal of No Objection Certificate to Existing Building of M/s Narayana Medical College Hospital of Narayana Group of Medical Institutions), represented by Sri R.Sambasiva Rao, Sy.No.169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District-Regarding.

Ref: 1. Occupancy NOC File No.15472/NLR/RFO/2020, Dt:18.12.2020 of Regional Fire Officer, Southern Region, Vijayawada.
2. Application of M/s Narayana Medical College Hospital of Narayana Group of Medical Institutions, represented by Sri R.Sambasiva Rao, Sy.No.169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District.

The Management of M/s Narayana Medical College Hospital of Narayana Group of Medical Institutions), represented by Sri R.Sambasiva Rao, Sy.No.169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District has requested to issue Renewal of No Objection Certificate by duly remitting the Renewal Fee towards Fire Precautionary Fee vide reference 2nd cited.

2) The No Objection Certificate for Occupancy Certificate was issued vide reference 1st cited to the Existing Building of M/s Narayana Medical College Hospital of Narayana Group of Medical Institutions, represented by Sri R.Sambasiva Rao, Sy.No.169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District with Ground + 03 Upper Floors with Built-up area of 38824.32 Sq.Mtrs., with a Height of 14.60 Mtrs., for Institutional Occupancy.

3) The management has submitted the Self-Certification report and stated that the furnished information is correct and it is noticed at any time that the information provided is false, they understand that Renewal of NOC deemed may be cancelled by the concerned authority.

4) In view of the above and taking into consideration of the larger public interest and in the context of the COVID-19 pandemic across the country and also based on the Self-Certification submitted by the management, the Renewal of No Objection Certificate is issued to the Existing Building of M/s Narayana Medical College Hospital of Narayana Group of Medical Institutions), represented by Sri R.Sambasiva Rao, Sy.No.169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District with Ground + 03 Upper Floors with Built-up area of 38824.32 Sq.Mtrs., with a Height of 14.60 Mtrs., for Institutional Occupancy subject to condition that shall provide the following Fire Fighting System and Electrical Safety System and to maintain in good working condition at all time.

Contd.....2P



A. Jee
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003

B. Jee
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003

Sl. No.	Fire Fighting Equipment	Prescribed	Required	To be Provided
			392 Nos.	Nil
1	Fire Extinguishers	ABC type		
2	Underground parking/ Cellar / Basement	Temperature Sensors connected " Hooter " and that can give alerts through Cell phone.	Not Applicable	
3	Manual Call Point System	One Number per Floor	31 Nos.	Nil
4	Under Ground Static Water Tank (or) Terrace Water Tank	5,000 Ltrs. (Minimum)	100000 Ltrs.	Nil
5	2 HP (Pump + Electrical Motors connected) @ one per Floor connected to Normal Plumbing System instead of Down Comer/Special Pipes.	One per each Floor	03 Nos.	01 No.
6	5 HP (Mobile Pump + Petrol Engine on wheels connected to Ground Floor Sump)	One Number	01 No.	01 No.

5) Electrical Safety System:


(i) Miniature Circuit Breakers, MCB's.	:	Yes/Provided
(ii) No Overloading of Power Sockets.	:	Yes
(iii) 10 years old wiring to be changed specially wherever A/c is there ?	:	Yes/Provided
(iv) LED Lights in Closed Rooms, Corridors, Staircases connected to Inverter (Battery).	:	Yes/Provided
(v) Grounding/Earthing is provided	:	Yes/Provided
(vi) Lightening Conductor is provided	:	NA
(vii) The above shall be certified by authorized Electrical Contractor/ Supervisor.	:	Yes/Provided


6) Fire Safety Suggestions:

Sl. No.	As Builder	As Occupant	As Security personnel
1.	All the Fire protection arrangements shall be maintained in good working condition at all time.	The Escape/Exit roots shall not be kept Locked/Blocked or Encroached.	All the occupants must be trained the correct method of operation of the Fire Fighting System installed.
2.	Any loss of life or property due to non-functioning of Fire Safety Measures and other Installations shall be the responsibility of the management.	All occupants shall be trained to operate the Fire Safety Equipment during Emergency.	Mock Drills should be conducted once in 03 months for initial two years. Thereafter, once in every 06 months.
3.	Addition/Alteration, if any in the Building may be verified by Building Authority.	Mock Drills should be conducted once in 03 months for initial two years. Thereafter, once in every 06 months.	All Security Personnel shall be trained to operate the Fire Safety Equipment during Emergency.
4.	This Annual Periodical Renewal Fire Certificate is only from Fire Safety Point of View.	Raise the alarm If the fire cannot be controlled, Evacuate the area completely at once with nearest Safe Exit.	Attack the Fire using available Fire Equipment only if you feel capable of controlling it. If not, take all steps to isolate the area by closing Doors and Windows.

Contd.....3P





 Principal
NARAYANA COLLEGE OF NURSING
 Chinthareddypalem,
 NELLORE - 524 003.


 Principal
NARAYANA COLLEGE OF NURSING
 Chinthareddypalem,
 NELLORE - 524 003

7) This Renewal of No Objection Certificate is **valid for a period of Five years** from the date of issue of this letter subject to the compliance of above Fire and Electrical Safety Measures. The Owner/Occupier/Builder/Management concerned of the Building shall submit Self Declaration/Certification with regard to working condition of above Fire Safety System every year in the prescribed format and submit/upload the photographs of the Mock Drills conducted in the premises. It is the responsibility of the Builder to maintain the Fire Safety Equipment in good working condition at all times and apply for next Periodical Renewal of No Objection Certificate, duly remitting the User Charges vide G.O.Ms.No.90, Home (Prisons & Fire Services) Department Dated:13.08.2021 & G.O.Ms.No.120, Home (Prisons & Fire Services) Department Dated:25.10.2021, two (02) months before expiry of this Renewal of No Objection Certificate.

Yours Sincerely,




Director General,
State Disaster Response and Fire Services,
Andhra Pradesh, Vijayawada.


Copy to the Management, M/s Narayana Medical College Hospital of Narayana Group of Medical Institutions), represented by Sri R.Sambasiva Rao, Sy.No.169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District.

Copy to Regional Fire Officer, Southern Region, Vijayawada.
Copy to District Fire Officer, SPSR Nellore.

Note: In case of any emergency call to 101 or State Fire Control Room-9100108101.


Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003




Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.

GOVERNMENT OF ANDHRA PRADESH
STATE DISASTER RESPONSE & FIRE SERVICES DEPARTMENT

From :
The Director General,
State Disaster Response and Fire Services,
Andhra Pradesh, Vijayawada.

To :
The District Medical & Health
Officer, SPSR Nellore District.

Rc.No. 1949/MSB/SR/NLR/2021, Dt: 03.12.2021

Sir,

Sub: A.P. State Disaster Response and Fire Services Department- MSB Section - Issuance of No Objection Certificate for Occupancy to Existing Building of Narayana Super Specialty Hospital located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District -Regarding.

Ref: 1. This Office Temporary NOC for Occupancy Rc. No. 1949/DFO/SR/2021, Dt:12-05-2021.
2. Application of Narayana Super Specialty Hospital located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District.

It is to inform that, the Management has requested for issuance of No Objection Certificate for Occupancy to the Hospital Building of Narayana Super Specialty Hospital located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District in the reference 2nd cited.

2) The Management has obtained Temporary No Objection Certificate for Occupancy from this department vide reference 1st cited with Ground + (07) upper floors with a height of 23.86 Mtrs., in a total build up area of 42604 Sq. Meters., for Institutional Occupancy (C1). Now the Management has requested for issuance of Final No Objection Certificate for Occupancy.

3) Particulars of the Building:-

Address of the Building	:	Narayana Super Specialty Hospital located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District
Height of the building	:	23.86 Meters
No. of Blocks	:	01 Block/ Ground+ (07) Upper Floors
Type of occupancy	:	Institutional Occupancy(C1)
Built up area	:	42604 Sq. Mtrs.

Contd...2p

B. Ghany
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003



A. S. Reddy
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.

4) The details of floor wise occupancies are furnished here below:

Sl.No	Floor	Area in Sq. Mtrs	Occupancy	Max No of Occupants allowed as per NBC
1	Ground	7208.00	Institutional -(C1)	480
2	1 st Floor	7208.00	Institutional -(C1)	480
3	2 nd Floor	7208.00	Institutional -(C1)	480
4	3 rd Floor	7208.00	Institutional -(C1)	480
5	4 th Floor	3443.00	Institutional -(C1)	229
6	5 th Floor	3443.00	Institutional -(C1)	229
7	6 th Floor	3443.00	Institutional -(C1)	229
8	7 th Floor	3443.00	Institutional -(C1)	229
	Total	42604.00		2836

5) The Management has provided the following Means of Escape :

S. No	Details of Staircases	Required as per NBC -2016		Provided		Deficit		Remarks	Location
		No	Width in Mtrs	No	Width in Mtrs	No	Width in Mtrs		
1	Internal	01	02.00	01	02.00	--	--	Ground to 3 rd Floor	West-Middle
2	Internal			01	02.00	--	--	Ground to 3 rd Floor	West
3	Internal			01	02.00	--	--	Ground to 3 rd Floor	West
4	External	01	01.50	01	02.00	--	--	Ground to 3 rd Floor	South Middle
5	External			01	02.00	--	--	Ground to 7 th Floor	South Middle
6	External			01	02.00	--	--	Ground to 7 th Floor	South-West
7	External			01	01.83	--	--	Ground to 7 th Floor	North-West
8	External			01	02.00	--	--	Ground to 7 th Floor	North-West
9	Ramp	01	02.00	01	02.40	--	--	Ground to 7 th Floor	South-West
					18.23				

6) The details of Occupant Load per unit and exit width required and provided are furnished below.

Sl.No	Floor	Built-up Area In Sq.Mtrs	Max No.of Occupants Allowed as per Occupant Load	Means of Escape Required in Mtrs	Provided in Mtrs	Deficit
1	Ground	7208.00	480	06.24 Mtrs Doors	Provided	Nil
2	1 st Floor	7208.00	480	07.20	18.23	Nil
3	2 nd Floor	7208.00	480	07.20	18.23	Nil
4	3 rd Floor	7208.00	480	07.20	18.23	Nil
5	4 th Floor	3443.00	229	03.44	10.23	Nil
6	5 th Floor	3443.00	229	03.44	10.23	Nil
7	6 th Floor	3443.00	229	03.44	10.23	Nil
8	7 th Floor	3443.00	229	03.44	10.23	Nil
	Total	42604.00	2836	--	--	

Contd....3p

B. Anj
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003



A. J. Reddy
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003

7) The Management has provided the following Fire Fighting Systems

Sl. No	Fire Safety Measures	Required	Provided	Deficiency
1	Fire Extinguishers	426 No.s	426 No.s	Nil
2	Hose Reel Hose System	42 No.s	16 No.s	26 No.s
3	Wet Riser	07 No	03 No.s	04 No.s
4	Automatic Sprinkler System	3550 No.s	3550 No.s	Nil
6	Manually Operated Fire Alarm System	68 No.s	68 No.s	Nil
7	Automatic Detection Alarm System	761 No.s	761 No.s	Installed, but not programmed and Not in working Condition
8	Under Ground Static Tank	1,50,000 Ltrs	1,50,000 Ltrs	Nil
9	Terrace Tank	20,000 Ltrs	20,000 Ltrs	Nil
10	Electrical Pump of Capacity 2280 LPM	01 No	01 No	Nil
11	Diesel Pump of Capacity 2280 LPM	01 No	01 No	Nil
12	Electrical Pump of Capacity 180 LPM	01 No	01 No	Nil
13	Booster Pump of Capacity 900 LPM	NA	01 No	Nil
14	2HP Motor with Triplex pump	04 Nos.	04 Nos.	Nil

8) The Management shall ensure the following fire safety measures.

Sl No	Fire Safety Measures	Remarks
1	Electrical Safety: MCB @Floor	Provided
2	Electrical Safety Check list	Ensured
3	IR Detector to check overheating in circuits	To be Provided
4	Two Staircases (or) Adjacent Building attachment with Horizontal exit allowance	Provided
5	Openable windows in the corridors & Staircases	To be ensured
6	UPS backup power supply for corridors & staircases with illumination of lights.	Ensured
7	CO2/ABC Extinguishers one trolley @Floor	Provided
8	Manually Electric Fire Alarm.	Provided
9	Smoke Detector in all A/C. rooms	Provided
10	Hose Reel	Provided
11	Down Comer/Wet Riser	Provided
12	Yard Hydrants	Provided
13	Terrace pump 900 LPM/Under Ground Pump 1620 LPM	01 No. of Electrical Pump of 2280 LPM, 01 No. of Diesel Pump of 2280 LPM, 01 No. of Jockey Pump of 180 LPM & 01 No. of Booster pump 900 LPM
14	U/G Tank more than 35,000 Ltrs	1,50,000 Ltrs provided
15	Terrace Tank more than 25,000 Ltrs	20,000 Ltrs Provided
16	900 LPM/1620 LPM pump + 180 LPM Jockey pump connected to DG set backup with auto mode.	To be connected
17	Posters with Police/ Ambulance/ fire Service Numbers.	To be ensured

Contd....4p

B. Princy
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003



A. S. Reddy
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.

9) **Electrical Safety and Fire Safety Plan & Fire Drills:**

Electrical Safety in entire Hospital	1. Electrical wiring and installations shall be certified by an Electrical Engineer and Fire Safety of batteries system in UPSs to be checked in particular.	Certified
	2.) a) Fast acting Miniature Circuit Breakers (MCB's) to control short circuits before they can develop into fires .	Provided
	b) External main power switches to enable isolate power and forestall short circuits and consequent fires, in the premises, when it is not manned.	Ensured
	c) Security/Fire alarms and Emergency lighting to remain powered through separate low power well protected ancillary circuits.	Ensured
	d) Install Emergency lighting system	Installed
	e) Smoke Detector with Alarm shall be provided	Provided
	f) Change wiring if the wiring or building is more than 10 years old (as most fire accidents in Hospitals are due to Short Circuits).	Shall be ensured
	g) Install "LED" lights in closed rooms, corridors and staircases. Let them be connected to "inverter" so that in case of Emergency, they provide much needed light to escape.	
	h) Clearly mark signages (exit, corridors & staircases).	
	i) Please put lightening protection (wherever applicable) and proper grounding.	
j) Provide sufficient plugs so that there will not be any "Overloading" in future.		
k) The above shall be certified by a licensed Electrician with display of approved "Circuit Drawing" in Ground floor.		

9) The Management is responsible all risks involved in case of Fire Accident.

10) In view of the above and taking into the consideration of larger public interest and in context of the COVID-19 Pandemic Crisis across the country due to an acute shortage of beds to the patients and also based on the inspection committee, the No Objection Certificate for Occupancy is issued to the existing building of Narayana Super Specialty Hospital located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District for a period of (05) years. The Management shall ensure the following precautions strictly at all the times:

INCASE OF FIRE:

- Raise the Alarm and alert the working staff.
- Use right/appropriate extinguisher i.e., ABC or CO2 Extinguisher to stop the Fire.
- Inform the Fire Brigade by calling 101 or 9100108101.
- Evacuate the patients / attendants to a safer place.
- Ensure that, the fire to be confined to a wing / Department/Floor with Fire door.
- The patients to be evacuated in Smokey corridors/staircases by bend and crawl position to ground/safer places.
- The Fire/Escape routes should not be locked/blocked.
- Electrical safety devices such as MCBs, Switches and fuses should conform to correct rating of Circuits.
- Watch and Ward system shall be maintained in ICU and other Critical Care Units so as to attend any Fire Emergencies.
- The exit Signage's to be displayed at Staircases and Ramps and Battery Operated Emergency Lights shall be installed in these places including corridors.

Contd....5p

B. Arjun
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003



[Signature]
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.

11) It is informed that, the Management of Narayana Super Specialty Hospital located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District is requested to maintain the following conditions compulsorily for safety purpose.

Sl.No.	As Builder	As occupant	As Security Personnel
1	All the fire protection arrangements shall be maintained in good condition as seen during inspection.	All the escape/exit routes shall not be kept locked/blocked or encroached	All the occupants must know the correct method of operation of the fire fighting system installed.
2	Any loss of life or property due to non-functioning of fire safety measures and other installations shall be the responsibilities of the management.	All occupants shall be trained to operate the fire safety equipments during emergency.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.
3	Addition / alteration, if any in the building may be verified by building authority.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.	All security personnel shall be trained to operate the fire safety equipments during emergency.
4	This No objection Certificate for occupancy is issued from fire safety point of view.	Raise the alarm if the fire cannot be controlled; Evacuate the area completely at once with nearest safe exit.	Attack the fire using available fire equipment only if you feel capable of controlling. If not, take all steps to isolate the area by closing doors and windows.

12) This No Objection Certificate for Occupancy is **valid for a period of Five years** only from the date of issue of this letter. The owner/ Occupier/ Builder/ Management concerned of the building shall submit self declaration/ Certification every year in the prescribed format and submit/upload the photographs of the Mock drills conducted in the premises. It is the responsibility of the builder to apply for Renewal of No Objection Certificate for Occupancy, duly remitting the User Charges as per G.O.Ms.No.90, Home (Prisons & Fire) Department, dated.13-08-2021 and G.O.Ms.No.120, Home (Prisons & Fire) Department, Dated.25-10-2021 before expiry of this No Objection Certificate.

Yours sincerely,



Director General,

State Disaster Response and Fire Services,
Andhra Pradesh, Vijayawada.


Copy to the Management of Narayana Super Specialty Hospital located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chinthareddypalem, Nellore, SPSR Nellore District.

Copy to District Fire Officer, Nellore, SPSR Nellore District.

Note: In case of any emergency call to 101 or State Fire Control Room-9100108101.


Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003




Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.

GOVERNMENT OF ANDHRA PRADESH
STATE DISASTER RESPONSE & FIRE SERVICES DEPARTMENT

From :
The Director General,
State Disaster Response and Fire Services,
Andhra Pradesh, Vijayawada.

To :
The District Medical
& Health Officer,
Krishna District.

Rc.No.7130/MSB/ER/2021, Dt: 17.12.2021

Sir,

Sub: A.P. State Disaster Response and Fire Services Department- MSB Section - Issuance of No Objection Certificate for Occupancy to Existing Building of Narayana Outpatient Block located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chithareddypalem, Nellore, SPSR Nellore District- Regarding.

- Ref:**
1. Inspection committee Report Rc.No. Dated:26-05-2021.
 2. This Office Conditional NOC Rc.No. 972/DFO/NLR/2021, Dated:01-06-2021.
 3. Application of Narayana Outpatient Block located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chithareddypalem, Nellore, SPSR Nellore District.

The Management has requested for issuance of No Objection Certificate for Occupancy to the existing Building of Narayana Outpatient Block located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chithareddypalem, Nellore, SPSR Nellore District in the reference 3rd cited.

2) The Management has not obtained Provisional No Objection Certificate; the Conditional NOC obtained vide reference 2nd cited from this Department and now applied for No Objection Certificate for Occupancy.

3) The Inspection Committee has inspected the premises of Narayana Outpatient Block located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chithareddypalem, Nellore, SPSR Nellore District on 26-05-2021 and based on the Self Certification report of the Management, Narayana Outpatient Block located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chithareddypalem, Nellore, SPSR Nellore District vide reference 3rd cited. The existing building details shown below.

4) **Particulars of the Building:-**

Address of the Building	:	Narayana Outpatient Block located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chithareddypalem, Nellore, SPSR Nellore District
Height of the building	:	18.50 Meters
Plot/site area	:	2547.69 Sq. Mtrs.
No. of Blocks	:	01 Block/ Grpound + (05) Upper Floors
Type of occupancy	:	Institutional Occupancy
Built up area	:	6042.32 Sq. Mtrs.

Contd...2p

B. Prasad
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003



A. S. Reddy
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.

5) The Management has provided the following Means of Escape :

Sl. No	Details of Staircases	Required		Provided		Location
		No	Width in Mtrs	No	Width in Mtrs	
1	Internal Staircase	01	02.00	01	01.83	South-West
2	External Staircase	01	01.50	01	01.83	North-West

6) The details of floor wise occupancies are furnished here below:

Sl.No	Floor	Area in Sq. Mtrs	Type of Occupancy	Max No of Occupants allowed	MOE Required in Mtrs	Provided in Mtrs.
1	Ground	1291.27	Institutional -(C1)	129	01.67 Mtrs Doors	Provided
2	1st Floor	950.21	Institutional -(C1)	95	01.43	03.66
3	2nd Floor	950.21	Institutional -(C1)	95	01.43	03.66
4	3rd Floor	950.21	Institutional -(C1)	95	01.43	03.66
5	4th Floor	950.21	Institutional -(C1)	95	01.43	03.66
6	5th Floor	950.21	Institutional -(C1)	95	01.43	03.66
	Total	6042.32				

7) The Management has provided the following Fire Fighting Equipment keeping in view of practicality, maintenance and resilience.

Sl No	Fire Fighting Equipment	Prescribed	Provided	Deficit
1	Fire Extinguishers	ABC type	61 Nos.	Nil
2	Underground parking /Cellar / Basement	Temperature Sensors connected "Hooter" and that can give alerts through cell phone	Not applicable	Nil
3	Manual Call point	One number per floor	93 Nos.	Nil
4	Under Ground Static Water Tank (or) Terrace Water Tank	5,000 Ltrs (minimum)	1,50,000 Ltrs.	Nil
5	2 HP (Pump + Electrical Motors connected) @ one per floor connected to normal plumbing system instead of down comer/special pipes.	One per each floor (Total 6 floors)	03 Nos.	03 Nos.
6	5 HP (Mobile Pump + Petrol Engine on wheels by connecting at Ground floor sump)	One number	required	01 No.

Contd...3p

B. Anny
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003



A. S. S. S.
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.

8) The Management has provided the following Electrical Safety system.

(i) Miniature Circuit Breakers, MCBs	:	Provided
(ii) No overloading of Power sockets	:	Yes
(iii) 10 years old wiring to be changed specially wherever A/c is there ?	:	Provided
(iv) LED Lights in closed Rooms, Corridors, Staircases connected to Inverter (Battery)	:	Provided
(v) Grounding/Earthing is provided	:	Provided
(vi) Lightening Conductor is provided	:	Yes
(vii) The above shall be certified by authorized Electrical Contractor/Supervisor.	:	

9) The inspection committee has tested the provided fire safety systems and found in working condition.

10) The Management is responsible all risks involved in case of Fire Accident.

11) In view of the above and taking into the consideration of larger public interest and in context of the COVID-19 Pandemic Crisis across the country due to an acute shortage of beds to the patients and also based on the inspection committee report, the No Objection Certificate for Occupancy is issued to the existing building of Narayana Outpatient Block located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chithareddypalem, Nellore, SPSR Nellore District for a period of (05) years subject to the appropriate building permission from Municipal Corporations and the compliance of deficit Fire Fighting system within one year and report compliance to this office without fail.

12) The Management shall ensure the following precautions strictly at all the times:

INCASE OF FIRE:

- Raise the Alarm and alert the working staff.
- Use right/appropriate extinguisher i.e., ABC or CO2 Extinguisher to stop the Fire.
- Inform the Fire Brigade by calling 101 or 9100108101.
- Evacuate the patients / attendants to a safer place.
- Ensure that, the fire to be confined to a wing / Department/Floor with Fire door.
- The patients to be evacuated in Smokey corridors/staircases by bend and crawl position to ground/safer places.
- The Fire/Escape routes should not be locked/blocked.
- Watch and Ward staff shall be trained in Firefighting in ICU and other Critical Care Units so as to attend in Fire Emergencies.

13) This No Objection Certificate is issued, subject to the outcome of O.As/W.Ps etc., if any, before Courts etc.,

14) It is informed that, the Management of Narayana Outpatient Block located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chithareddypalem, Nellore, SPSR Nellore District is requested to maintain the following conditions compulsorily for safety purpose.

Contd...4p

B. Anuraj
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003




A. J. Reddy
Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003,
Scanned with CamScanner

Sl.No.	As Builder	As occupant	As Security Personnel
1	All the fire protection arrangements shall be maintained in good condition at all times.	All the escape/exit routes shall not be kept locked/blocked or encroached	All the occupants must train in correct method of operation of the fire fighting system installed.
2	Any loss of life or property due to non-functioning of fire safety measures and other installations shall be the responsibility of the management.	All occupants shall be trained to operate the fire safety equipments during emergency.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.
3	Addition / alteration, if any in the building may be verified by building authority.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.	All security personnel shall be trained to operate the fire safety equipments during emergency.
4	This No objection Certificate for occupancy is issued from fire safety point of view.	Raise the alarm if the fire cannot be controlled; Evacuate the area completely at once with nearest safe exit.	Attack the fire using available fire equipment only if you feel capable of controlling. If not, take all steps to isolate the area by closing doors and windows.

15) This No Objection Certificate for Occupancy is **valid for a period of Five years** only from the date of issue of this letter subject to the compliance of above Fire and Electrical Safety Measures. The owner/ Occupier/Builder/Management concerned of the building shall submit self declaration/ Certification with regard to working condition of fire safety measures every year in the prescribed format and submit/upload the photographs of the Mock drills conducted in the premises. It is the responsibility of the builder to apply for Renewal of No Objection Certificate for Occupancy, duly remitting the User Charges as per G.O.Ms.No.90, Home (Prisons & Fire) Department, dated.13-08-2021 and G.O.Ms.No.120, Home (Prisons & Fire) Department, dated.25-10-2021 before expiry of this No Objection Certificate.

Yours sincerely,

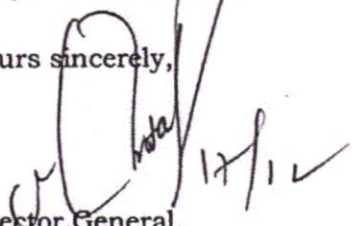

Director General,


State Disaster Response and Fire Services,
Andhra Pradesh, Vijayawada.

Copy to the Management of Narayana Outpatient Block located Sy.No:169 to 183, 184(P), 185(P), 186 to 188, 189(P) & 190(P), Chithareddypalem, Nellore, SPSR Nellore District.
Copy to the Regional Fire Officer, Southern Region, Vijayawada.
Copy to District Fire Officer, SPSR Nellore District.

Note: In case of any emergency call to 101 or State Fire Control Room-9100108101.




Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003.


Principal
NARAYANA COLLEGE OF NURSING
Chinthareddypalem,
NELLORE - 524 003